

DRAWING NUMBER
A-105
CAPTAIN FIREWORKS
105P M-2
9/10/17


DRAWING NUMBER

DRAWING NUMBER

DRAWING NUMBER

PLAN HOLD CORPORATION • BAKERSFIELD, CALIFORNIA


PLAN HOLD CORPORATION • BAKERSFIELD, CALIFORNIA

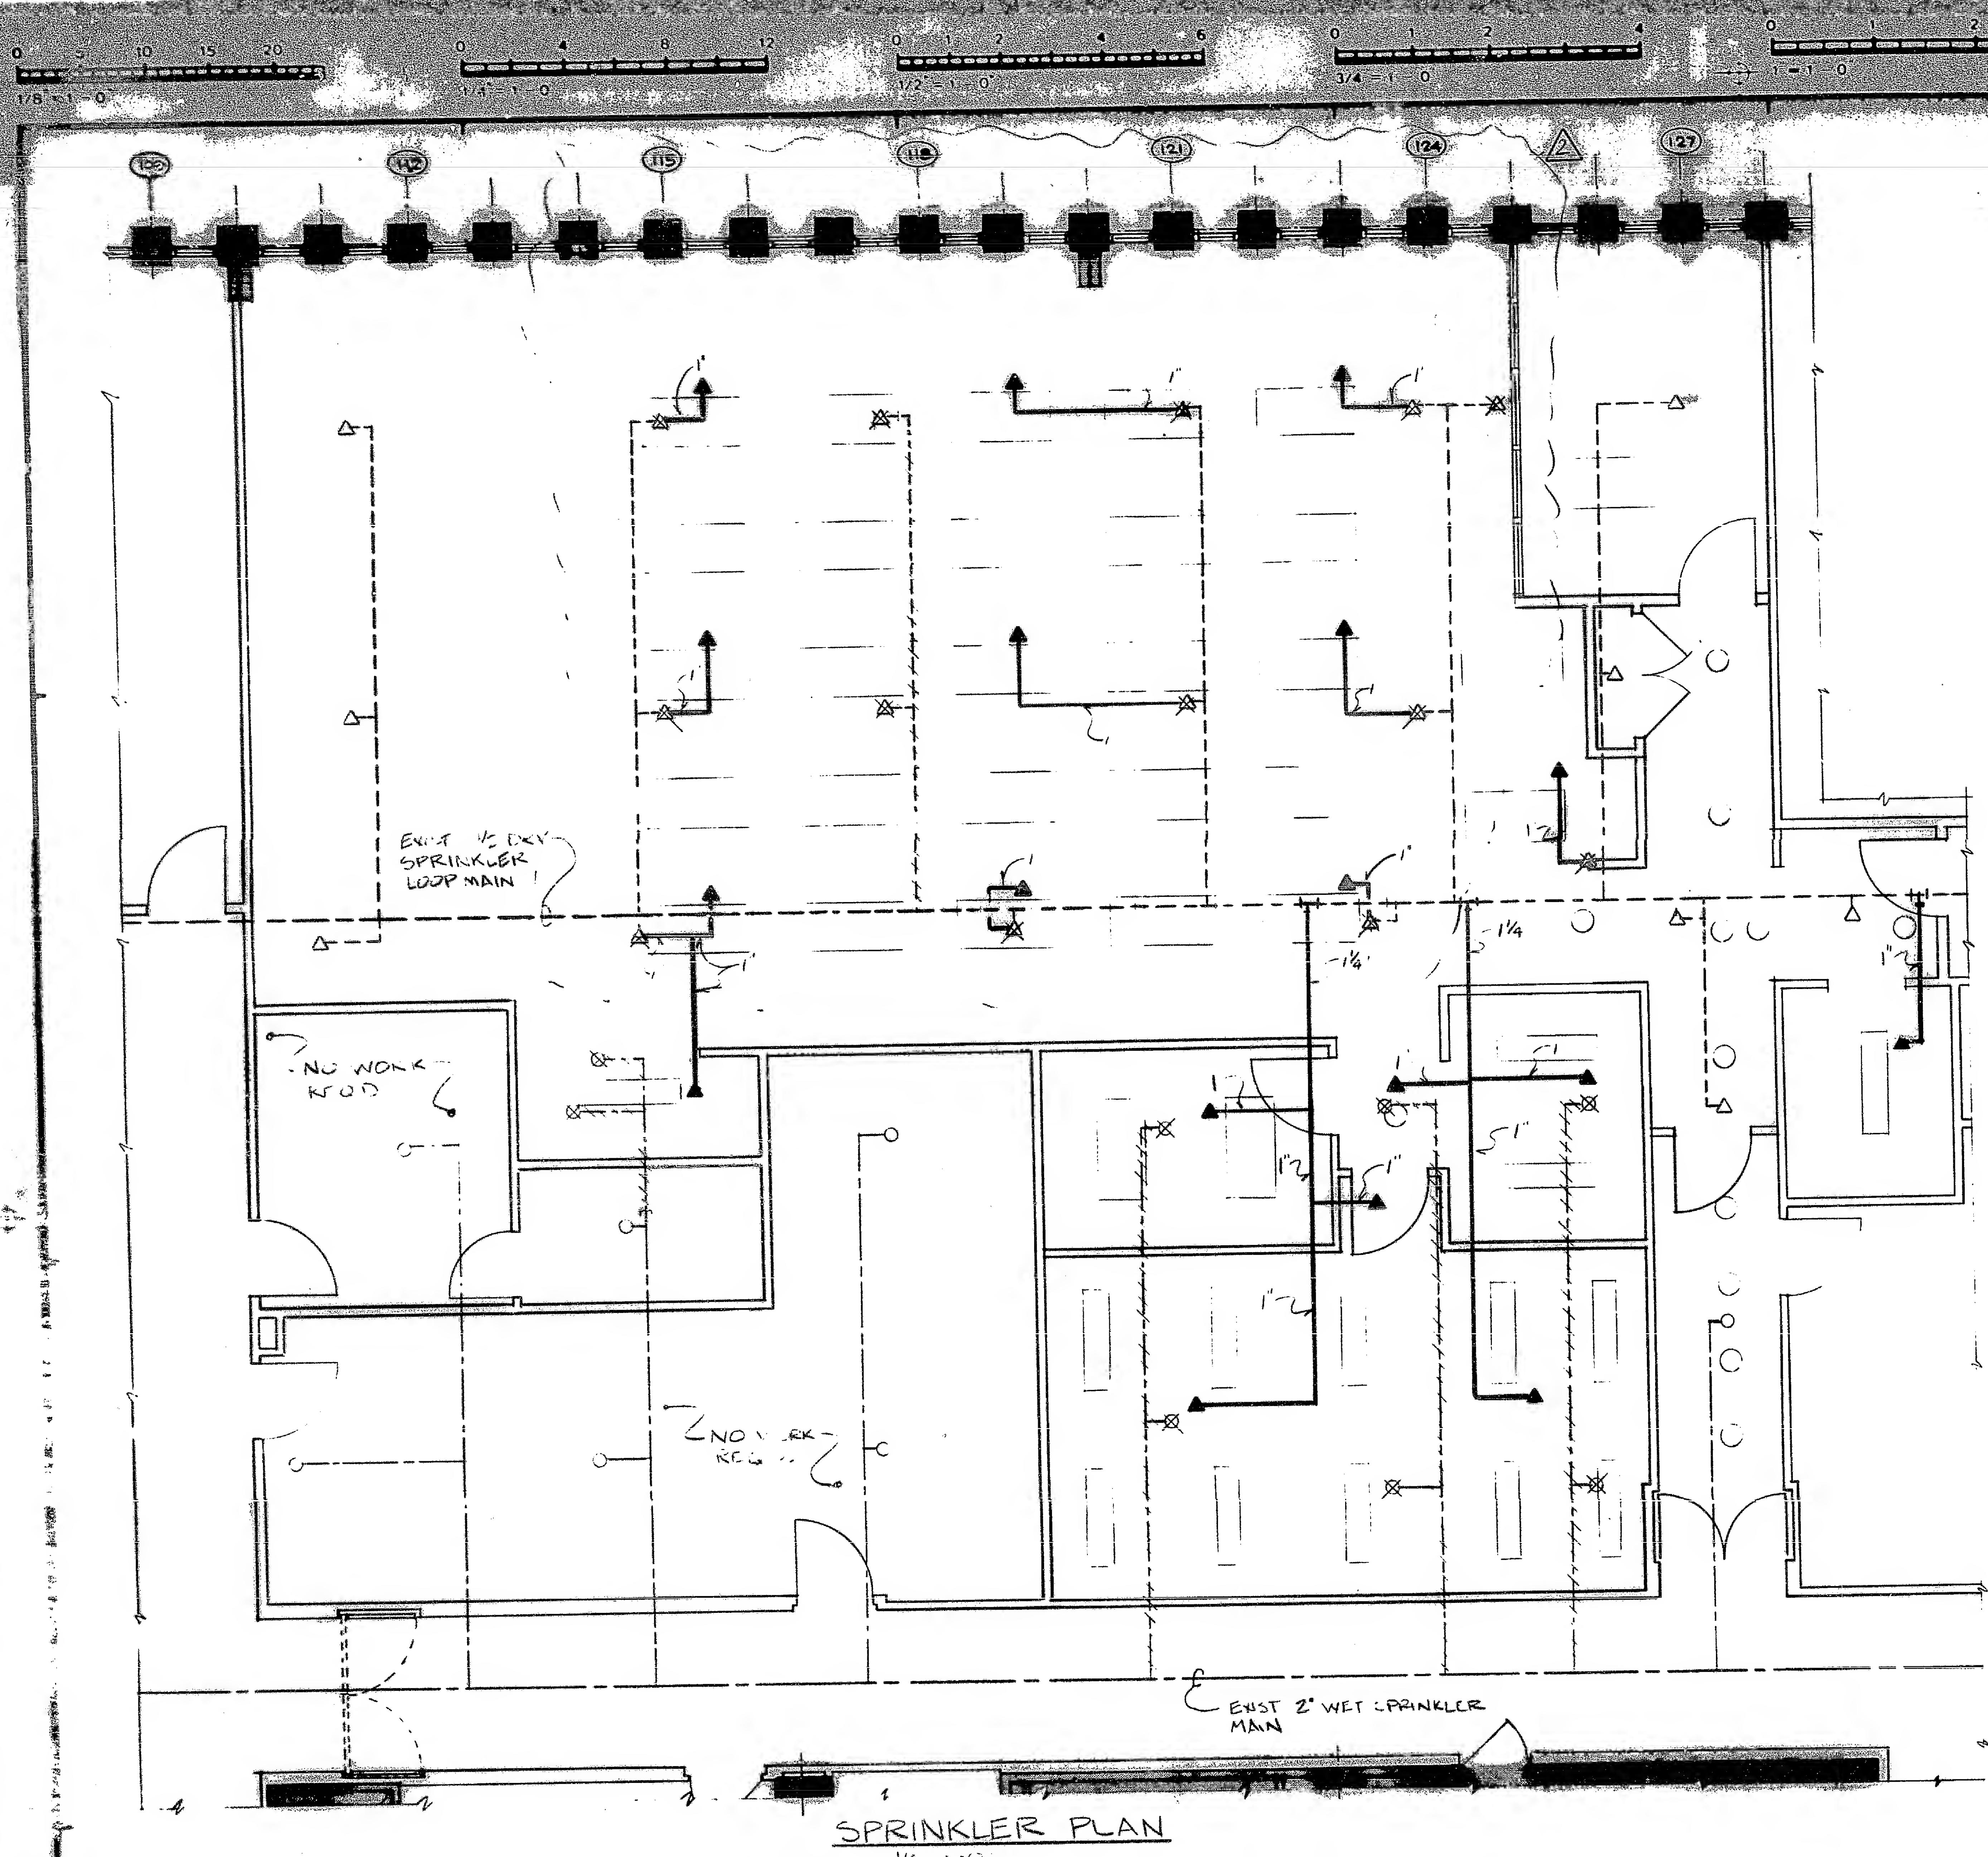


SPRINKLER PLAN
1/4" = 1'-0"

Note:
Insulation (including jacket or facing and adhesive) shall have a flame spread rating not greater than 25, smoke developed rating 50.

- LEGEND**
- ▲ RELOCATED PRE-ACTION SPRINKLER HEAD
 - △ EXISTING PRE-ACTION SPRINKLER HEAD TO REMAIN
 - ⊗ EXISTING PRE-ACTION SPRINKLER HEAD TO BE RELOCATED
 - EXISTING WET SPRINKLER HEAD TO REMAIN
 - ⊗ EXISTING WET SPRINKLER HEAD TO BE REMOVED
 - NEW PRE-ACTION PIPING
 - - - EXISTING PRE-ACTION PIPING
 - - - EXISTING PRE-ACTION PIPING TO BE REMOVED
 - - - EXISTING WET PIPING
 - - - EXISTING WET PIPING TO BE REMOVED

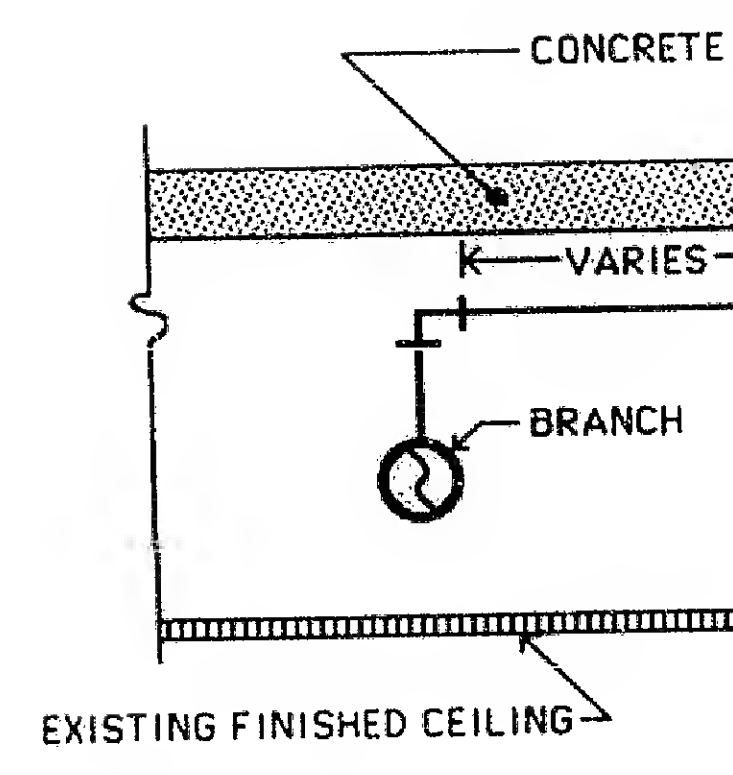

DETAIL OF TYPICAL CONNECTION TO EXISTING FINISHED CEILING
NOT TO SCALE

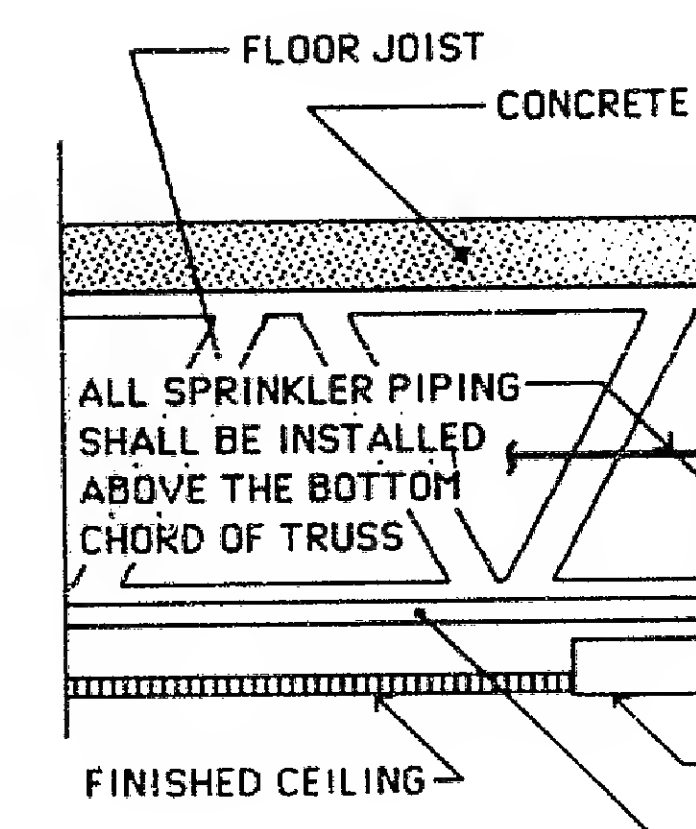

DETAIL OF LOCATION IN SUSPENDED CEILING
NOT TO SCALE